



SDGE  A Sempra Energy usiny	DEPARTMENT KEARNY MAINTENANCE AND OPERATIONS	DIVISION ELECTRIC TRANSMISSION AND DISTRIBUTION		DOCUMENT SECURITY  CONFIDENTIAL
Setupta chergy unity	SUBJECT STANDARD OPERATING PRACTICES			12/16/2024
		VERSION NUMBER 8G	TCM807 (AKA ESP807)	



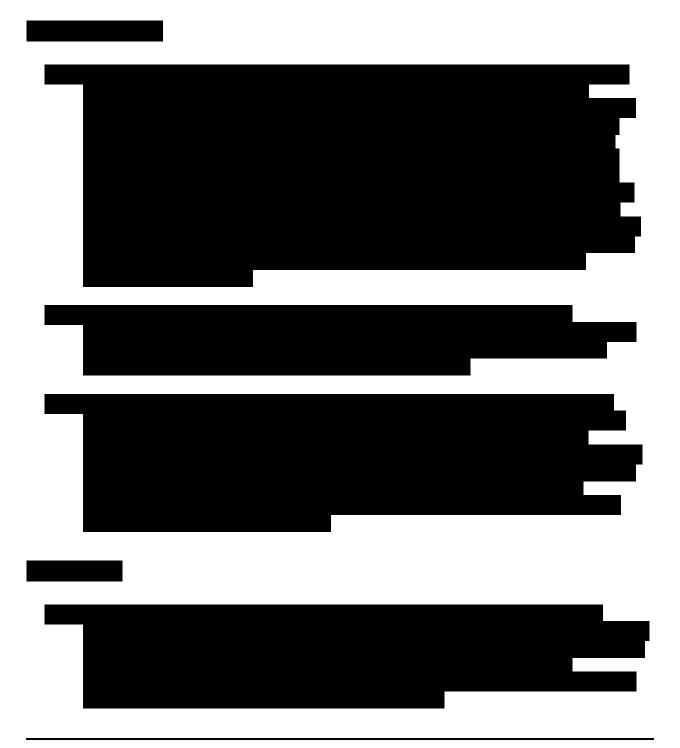

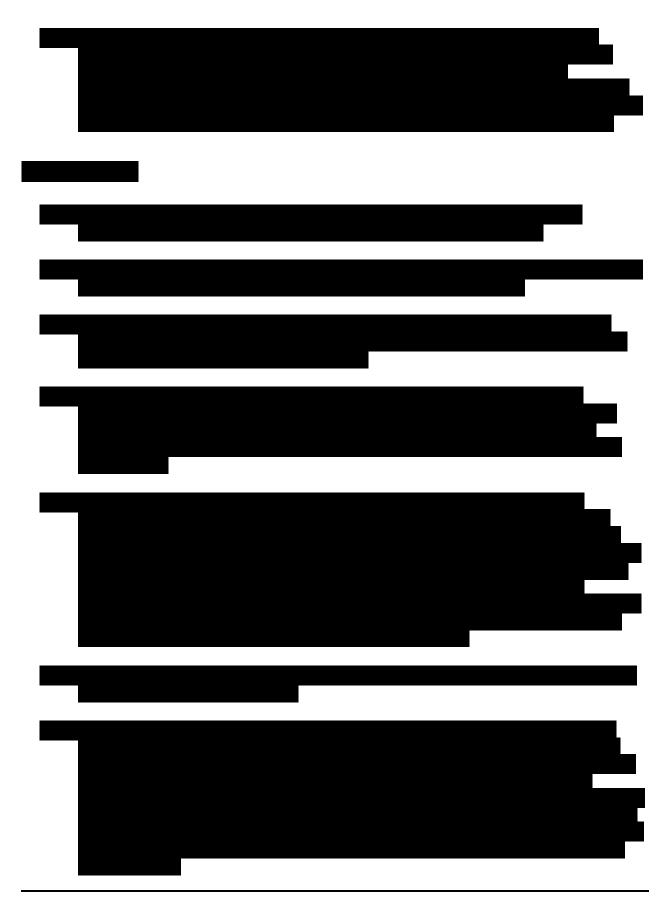


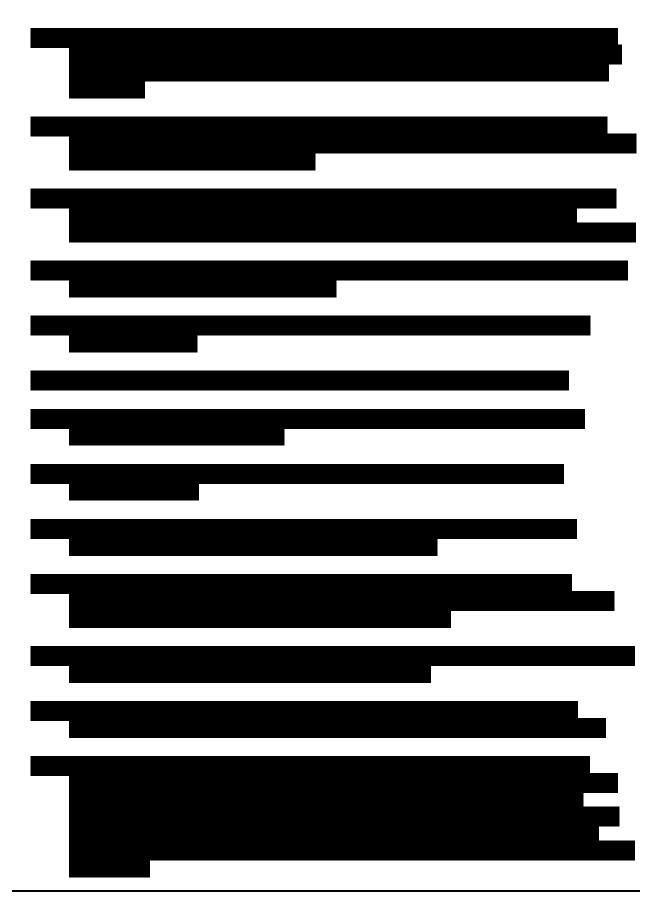

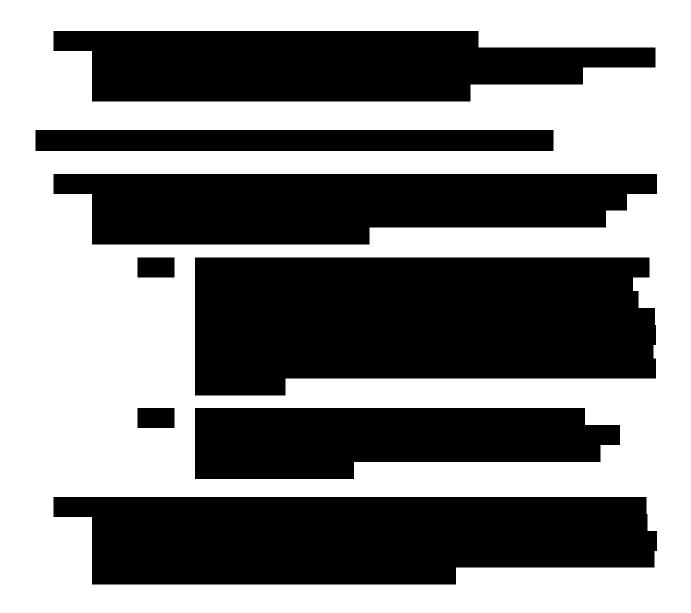






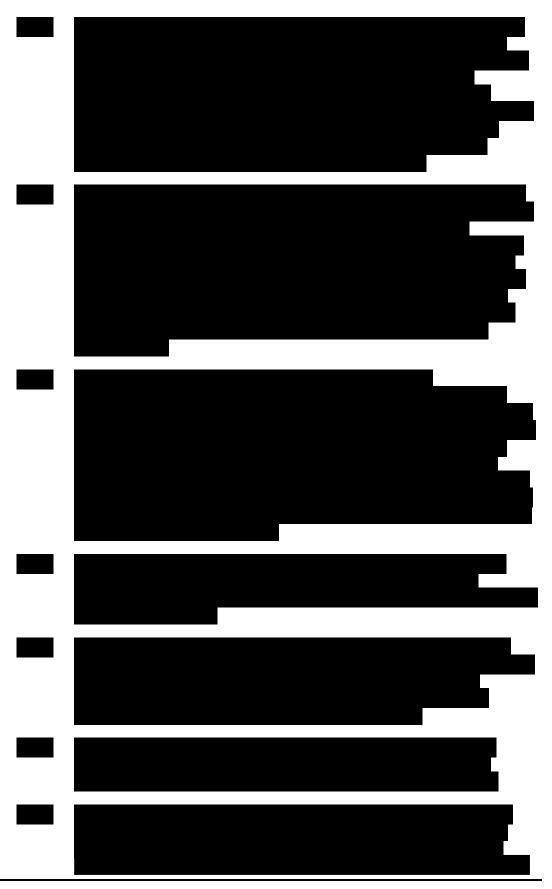




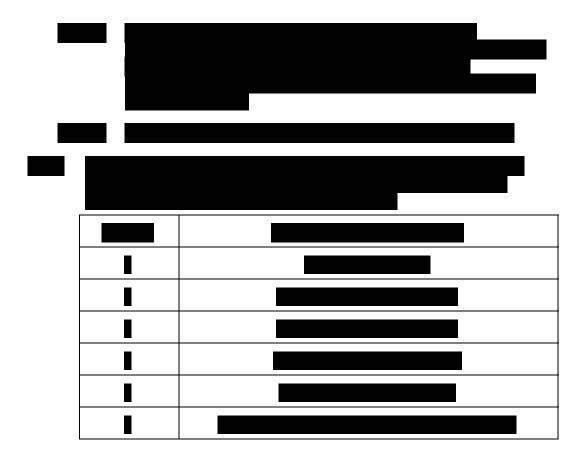










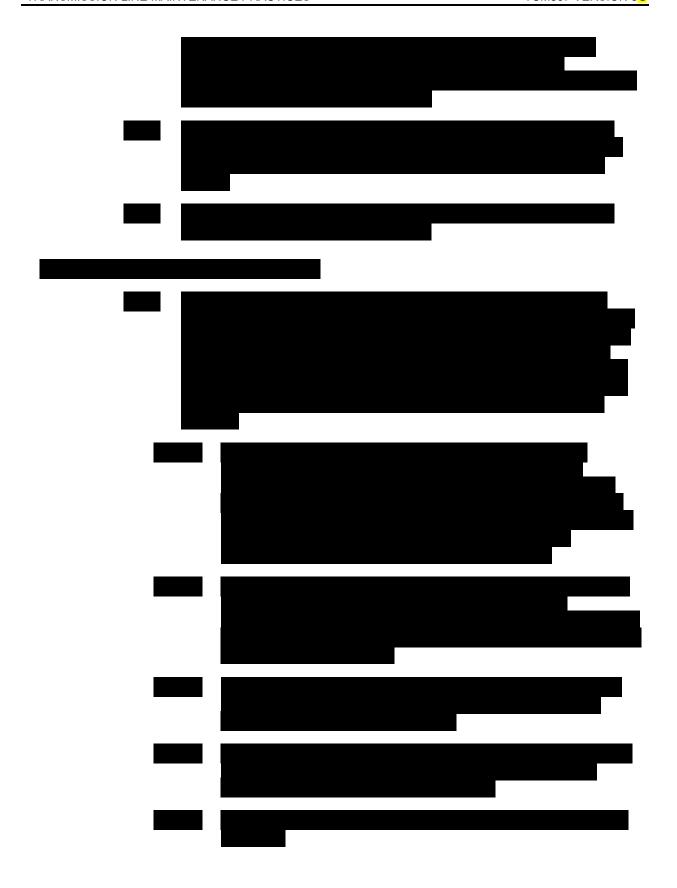


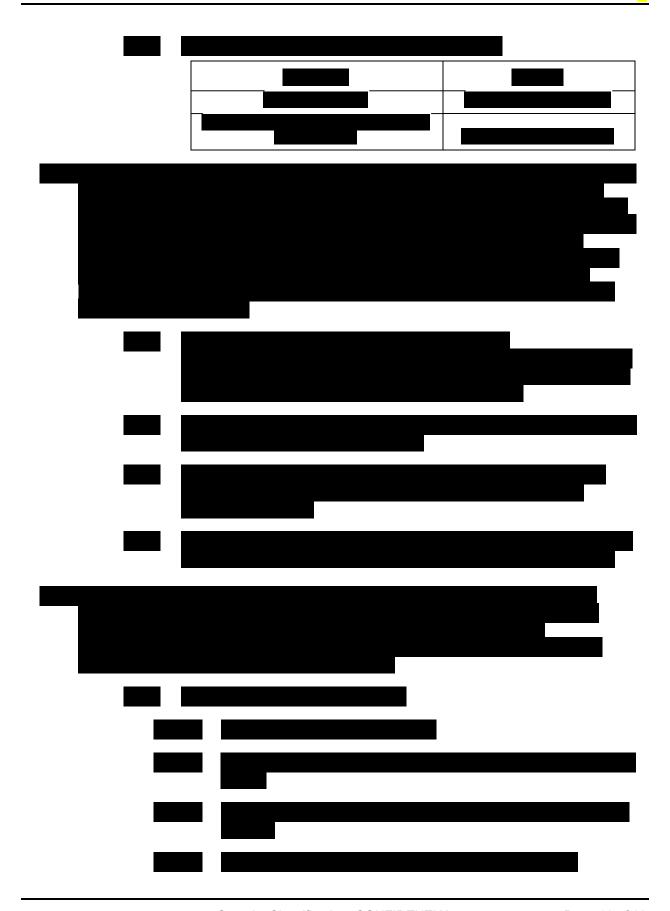


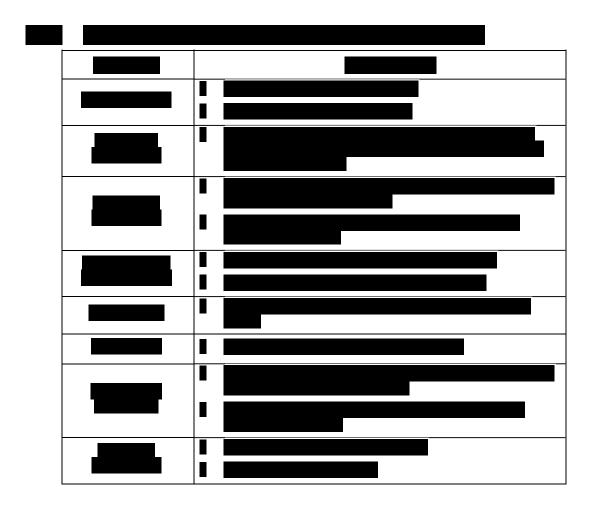





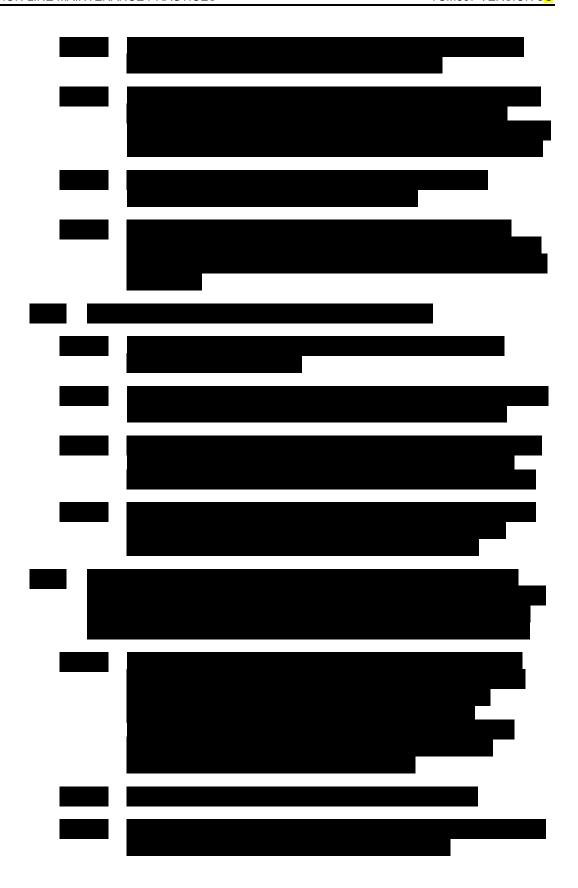


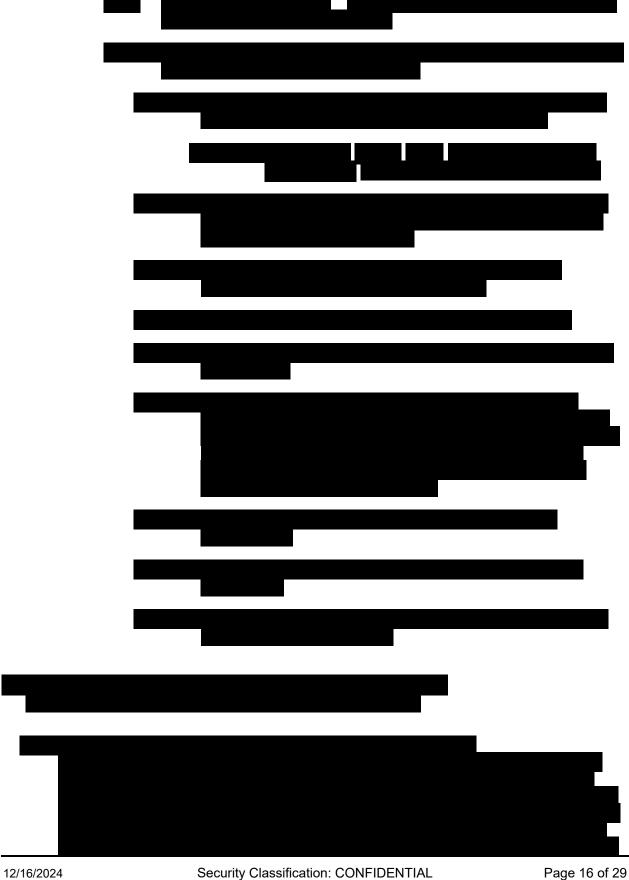


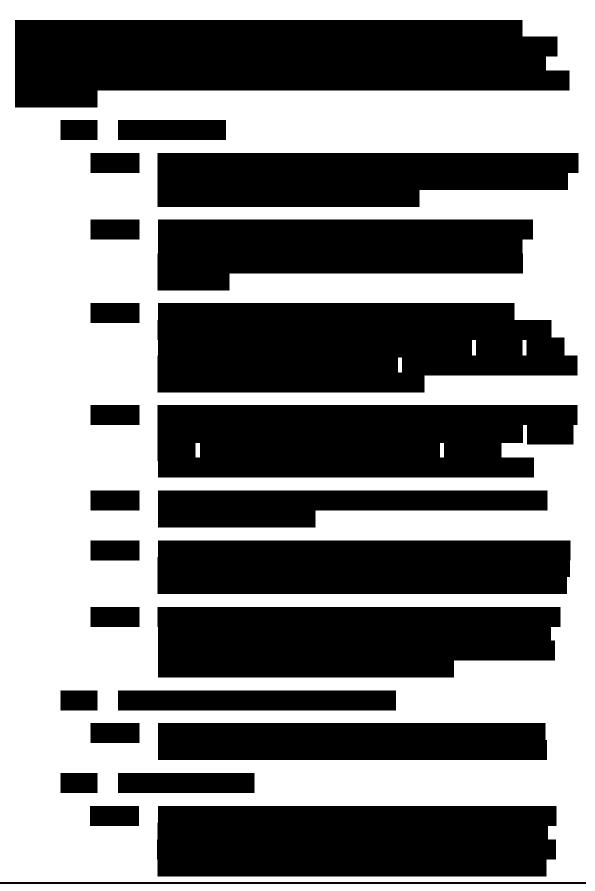


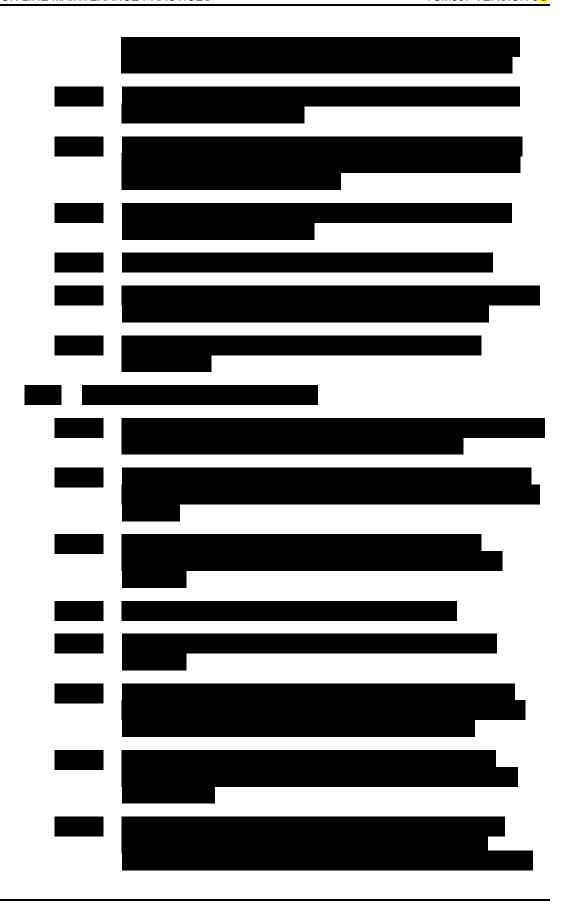


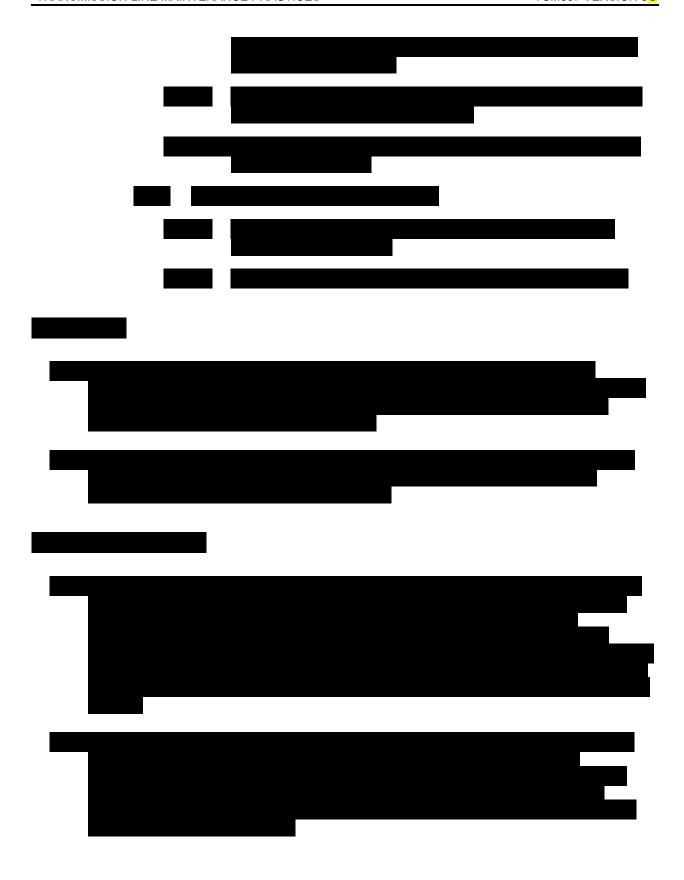

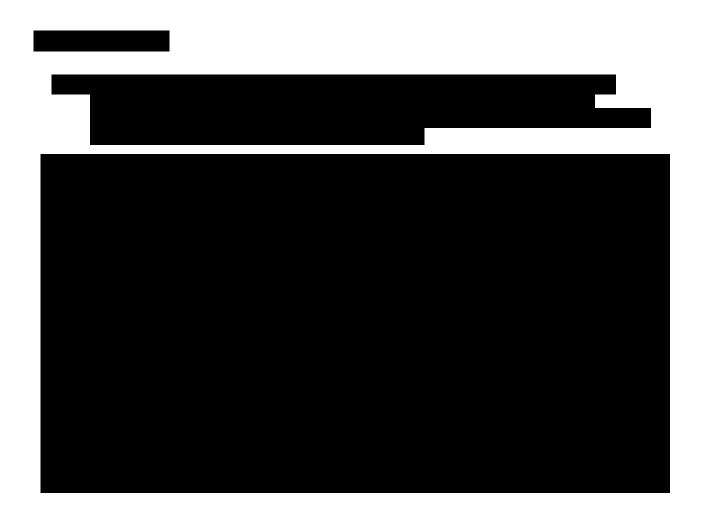


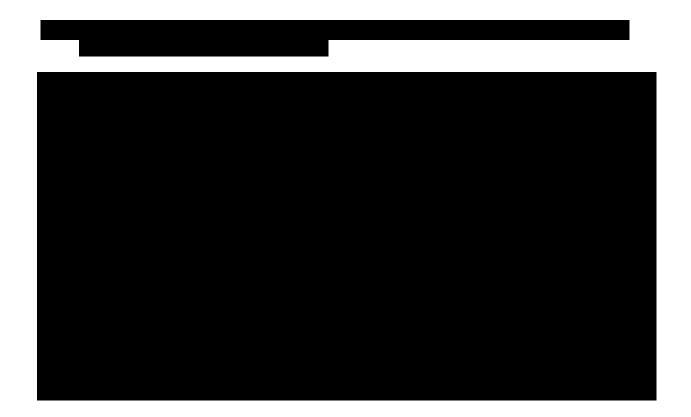

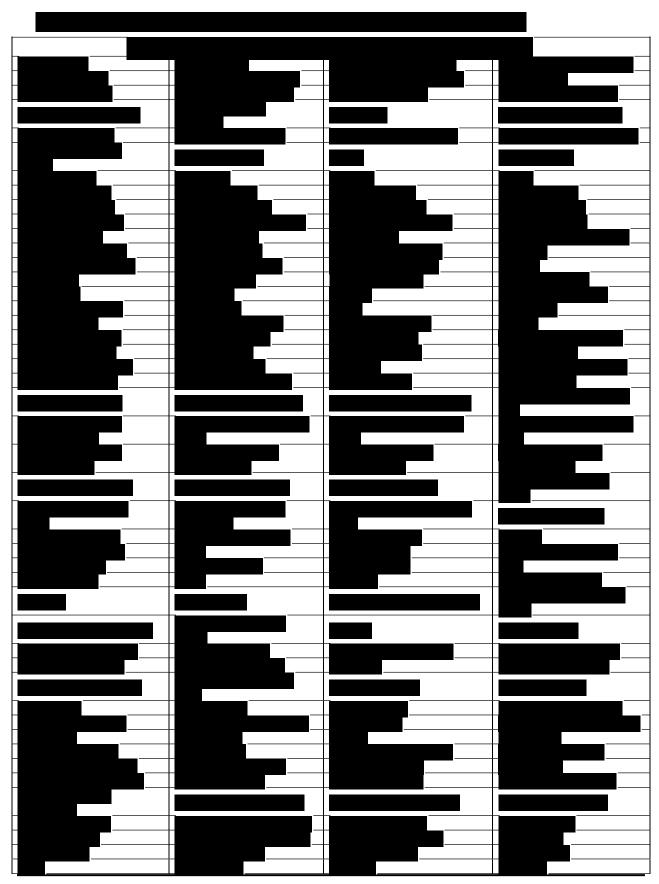

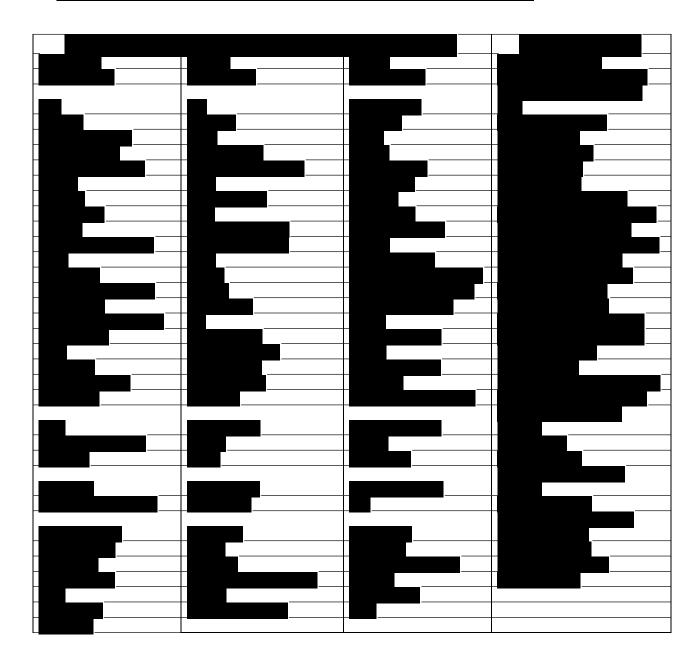




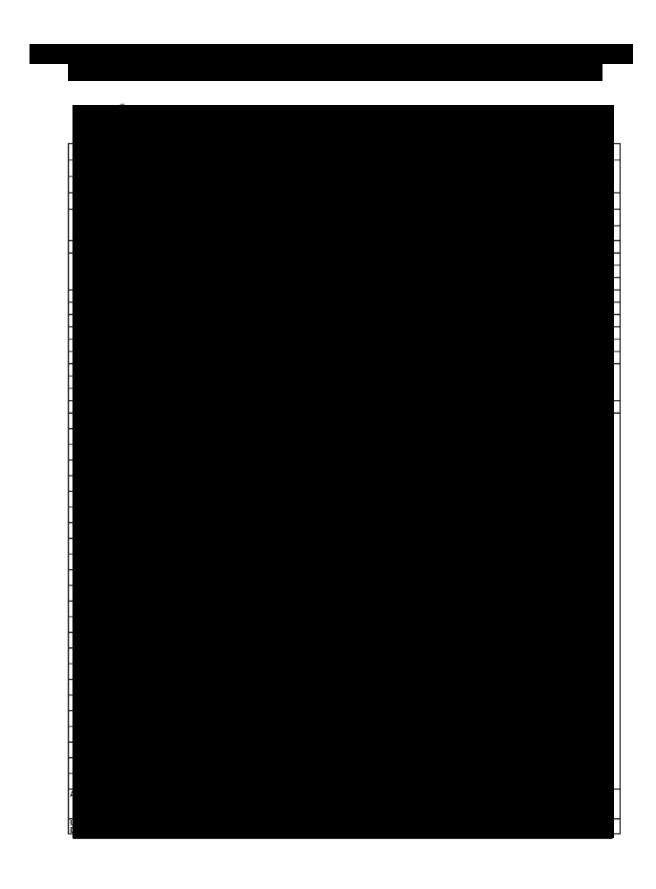






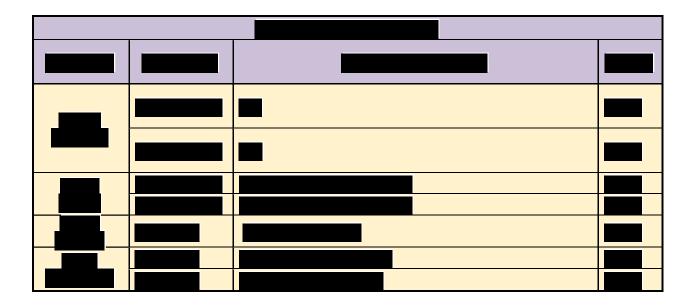



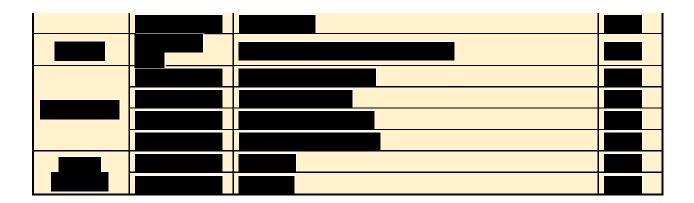

Titles	Name	Date
Approved By:	Transmission Construction & Maintenance Manager	12/16/2024
Authored By:	, Transmission Construction & Maintenance Team Lead	12/16/2024